

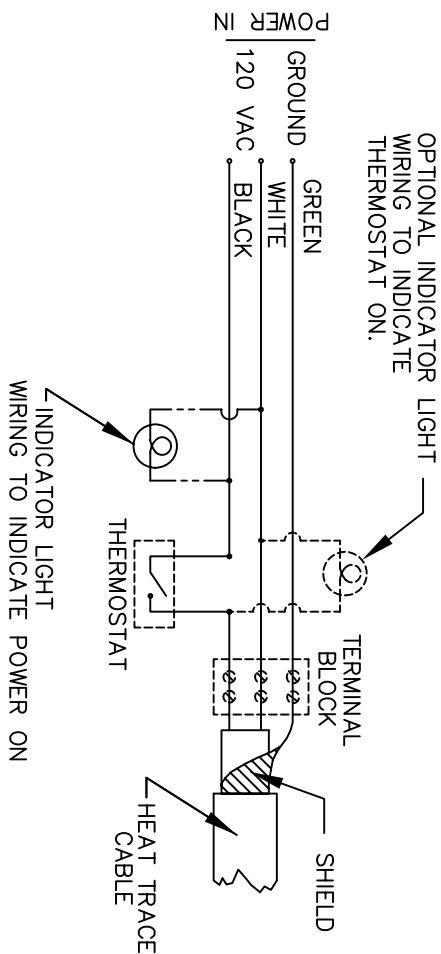


NOTES:

THERMOSTAT IS HERMETICALLY SEALED. INDICATOR LIGHT
IS NON ARCING DEVICE WITH GASKETED JUNCTION BOX SUITABLE
FOR CLASS 1, DIVISION 2, GROUP B,C,D AREAS BUT NOT SUITABLE
FOR DIVISION 1 AREAS.



8317 EXPLOSION PROOF INDICATOR LIGHT KIT INSTALLATION

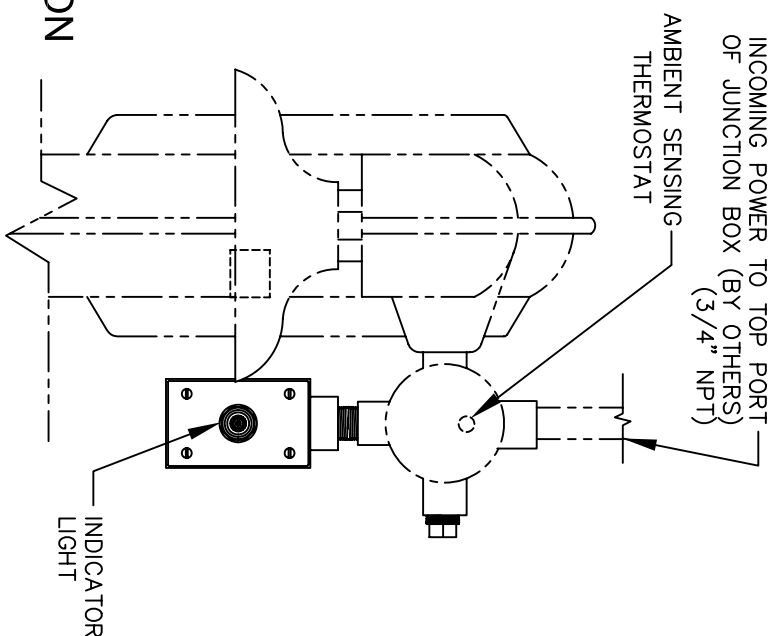

INFO FAX : 1-888-FAX-HAWS (1-888-329-4297)

1455 Kleppe Ln, Sparks NV, 89431

Phone: 775-359-4712 Fax: 775-359-7424

Haws Ag Bodlweg 3 CH-3401 Burgdorf Switzerland

Haws Mfg Pte Ltd 74 Sungai Kadut Loop Singapore 729531

e-mail: Haws@hawsco.com

website: www.hawsco.com

FORM NO.	REVISED FROM	DATE	BY	CHKD.	DATE	SCALE	DRAWING TYPE	INSTALLATION/FABRICATION	PART NUMBER	DRAWING NUMBER	REV
8317	8310	02/00				1:8	INSTALLATION/FABRICATION		0002080159	08441A00	4
MODEL(S): INDICATOR LIGHT, EXPLOSION PROOF										8317IDLTE-XP	
INFO FAX DOC # 283174358397											