

Job Name/Location:

Tag #:

Date:

For: ☐ File ☐ Resubmit

PO No.:

☐ Approval ☐ Other _____

Architect:

GC:

Engr:

Mech:

Rep:

(Company)

(Project Manager)

**LAN090HSV4**Multi F Art Cool™ Mirror - Wall Mount
9,000 Btu/h Indoor Unit**Performance:**

Nominal Cooling Capacity (Btu/h)	9,000
Nominal Heating Capacity (Btu/h)	10,400

Cooling Nominal Test Conditions:

Indoor: 80°F DB/67°F WB

Outdoor: 95°F DB/75°F WB

Heating Nominal Test Conditions:

Indoor: 70°F DB/60°F WB

Outdoor: 47°F DB/43°F WB

Electrical:

Power Supply (V ¹ /Hz/Ø)	208-230/60/1
Rated Amps (A)	0.20

Pipe Connections:

Liquid (in, OD)	1/4
Vapor (in, OD)	3/8
Drain OD, ID (in)	13/16, 5/8
Temperature Sensor	Thermistor

Controls Features:

- 4-Way auto swing
- 24-Hour on/off timer
- Auto operation
- Auto restart
- Chaos wind
- Inverter (variable speed fan)
- Jet Cool
- 3M HAF filter
- Self-cleaning indoor coil
- Sleep mode
- Condensate sensor connection
- Group control
- Smart AC module
- Compatible with Single Zone HSV4 ODU

Included Accessories:

- Wireless Remote Controller - AKB73835317

Optional Accessories:

- ☐ LG Programmable Thermostat - PREMTB10U
- ☐ Simple Controller with Mode (Black) - PQRCVCL0Q
- ☐ Simple Controller with Mode (White) - PQRCVCLOQW
- ☐ Simple Controller without Mode (Black) - PQRCHCA0Q
- ☐ Simple Controller without Mode (White) - PQRCHCA0QW
- ☐ AC Smart IV - PACS4B000
- ☐ ACP IV - PACP4B000
- ☐ LonWorks® Gateway - PLNWK100
- ☐ ACP IV BACnet® Gateway - PQNFB17C1
- ☐ Dry Contact Unit (1 contact, 24 VAC external power) - PQDSB1
- ☐ Dry Contact Unit (2 input, power from indoor unit) - PQDSBC
- ☐ Dry Contacts for third party thermostat - PQDSBNGCM1 or PDRYCB300

For a complete list of available accessories, contact your LG representative.

Entering Mixed Air:

Cooling (°F WB)	57-77
Heating (°F DB)	59-81

Unit Data:

Refrigerant Type	R410A
Refrigerant Control	EEV
Sound Pressure ² H/M/L (±3 dB(A))	33/30/27
Net Unit Weight (lbs)	24
Shipping Weight (lbs)	29

Fan:

Type	Cross Flow
Quantity	1
Motor/Drive	Brushless Digitally Controlled/Direct
Airflow Rate H/M/L (CFM)	247/230/212

Notes:

- Acceptable operating voltage: 187V - 253V.
- Sound Pressure levels are tested in an anechoic chamber under ISO Standard 1996.
- See Engineering Manual for sensible and latent capacities.
- All power/communication cable to be minimum 18 AWG, 4-conductor, stranded, shielded and must comply with applicable local and national code.
- Power wiring cable size must comply with the applicable local and national code.
- This unit comes with a dry helium charge.
- Corresponding refrigerant piping length is in accordance with standard length of each outdoor unit and the level difference is 0 ft. All capacities are net with a combination ratio between 95 - 105%
- Must follow installation instructions in the applicable LG installation manual.



Job Name/Location:

LAN090HSV4

Multi F Art Cool™ Mirror - Wall Mount


9,000 Btu/h Indoor Unit



Tag #:

Date:

PO No.:

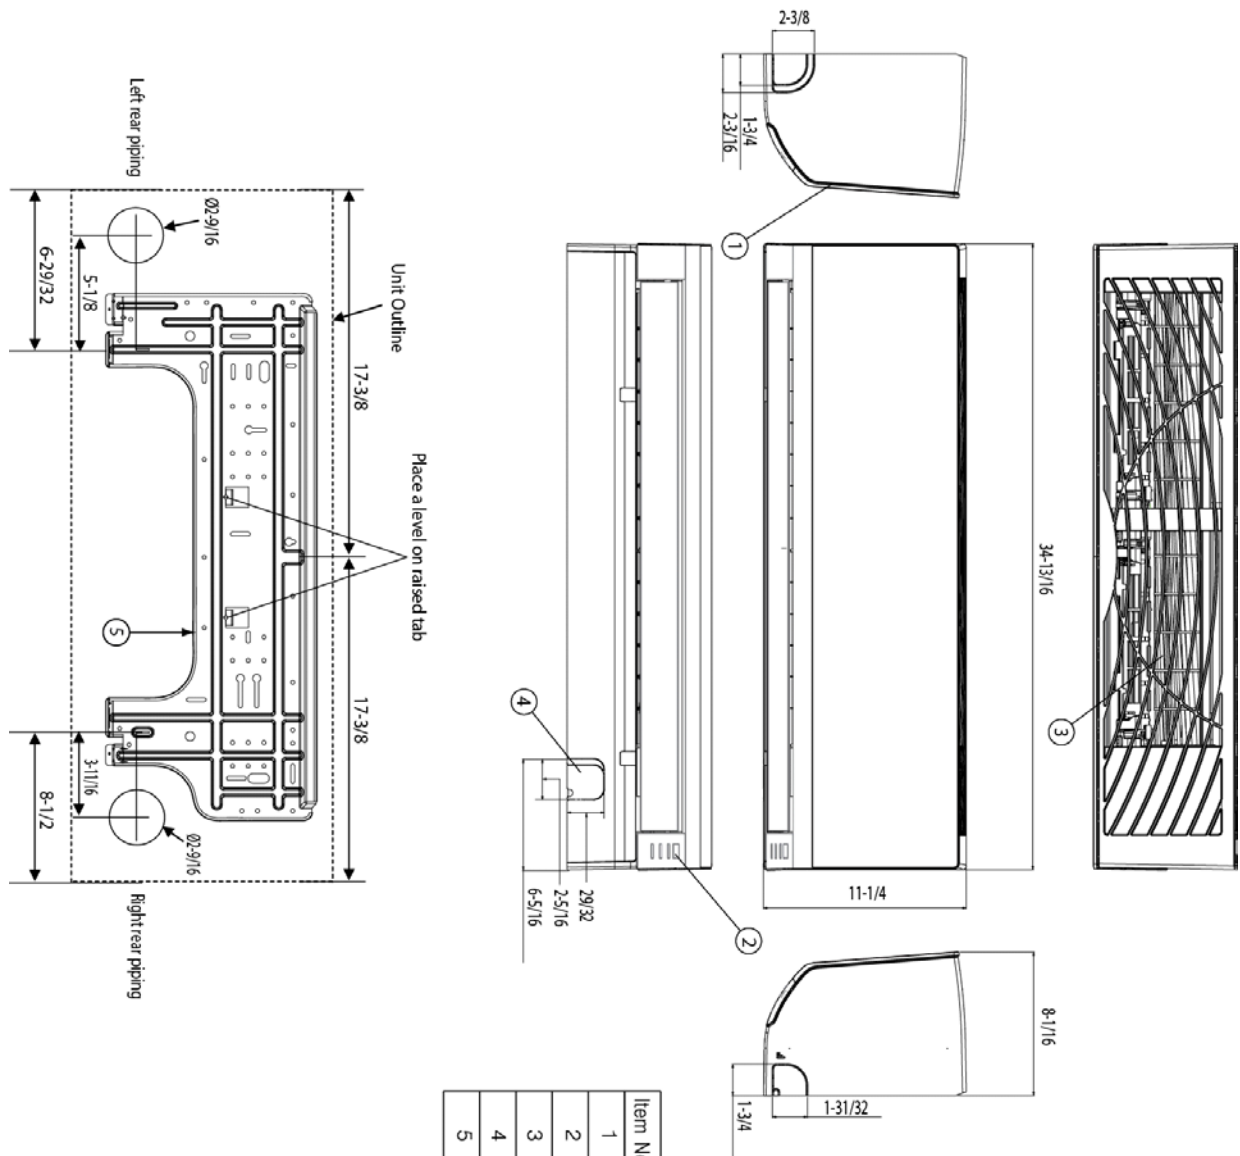

[Unit : inch]

Item No.	Part Name	Remark
1	Front Panel	
2	Display & Signal Receiver	
3	Return Air Grille	
4	Knockout hole	
5	Installation Plate	For pipe and cable