

Job Name:

Model No.:

NOTES:

Location:


Gal. Capacity:

Engineer:

Equipment Tag(s):

Agent/Wholesaler:

Contractor:

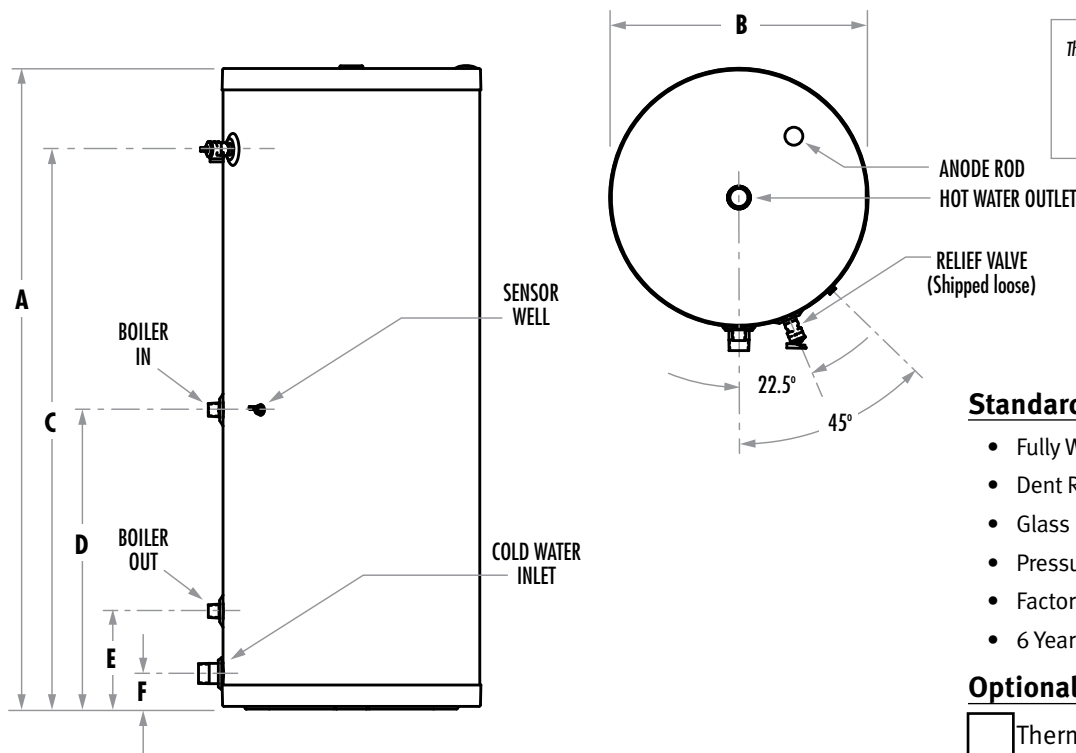

*The "Hot Water Outlet" connection is
Female NPT.*

*All other connections are
Male NPT.*

Standard Features

- Fully Welded Construction
- Dent Resistant Jacket
- Glass lined tank and heating coil
- Pressure Relief Valve included
- Factory Supplied Tank Sensor
- 6 Year Limited Warranty

Optional Equipment

☐ Thermostat

	MODEL NUMBER	A	B	C	D	E	F	HYDRONIC COIL CONNECTION SIZE	DOMESTIC WATER CONNECTION SIZE INLET	OUTLET	SHIP. WGT. (LBS.)
○	GIT040	55-3/4"	20"	48-7/8"	33-1/4"	8-1/4"	3-7/8"	1"	1"	1-1/4"	161
○	GIT050	47-1/2"	24"	39-3/4"	35-7/8"	9-1/4"	4"	1"	1"	1-1/4"	198
○	GIT080	64"	24"	57"	41-1/2"	9-1/4"	4"	1"	1-1/2"	1-1/2"	246
○	GIT119	66-1/2"	28"	58-1/2"	34-7/8"	9-1/2"	4"	1"	1-1/2"	1-1/2"	334

MODEL NUMBER	POTABLE WATER VOLUME (GALLONS)	STANDBY LOSS (°F/HR)	FIRST DRAW (GALLONS)	CONTINUOUS DRAW (GPH)	1ST HOUR RATING (GPH)	HEAT SOURCE			
						COIL VOLUME (GALLONS)	MIN. COIL LOAD (BTU/HR)	MIN. FLOW (GPM)	FRICTION LOSS (FT. HD.)
GIT040	42.0	1.8	39	157	196	2.5	99,000	14.0	1.9
GIT050	44.0	1.8	42	202	244	3.4	125,000	14.0	2.3
GIT080	72.0	1.5	66	255	321	4.9	167,000	14.0	1.1
GIT119	109.0	0.6	103	253	356	4.7	164,000	14.0	1.1

NOTE: These ratings were obtained with a heat source output rate and heat source flow rate shown in the table above. Other results will be obtained under different conditions.



Lochinvar®

HIGH EFFICIENCY BOILERS & WATER HEATERS

Lochinvar, LLC
300 Maddox Simpson Parkway
Lebanon, Tennessee 37090
P: 615.889.8900 / F: 615.547.1000



LOW LEAD CONTENT

    Lochinvar.com