

SAMSUNG

Submittal Data

AC009DNHDCG/AA (CNG09HDD) / AC009DXSCCG/AA (CXG09SCD)

Duct S, Single Zone, Heat Pump, Split System (Premium)

Job Name: _____

Purchaser: _____

Submitted to: _____

Unit designation: _____

Location: _____

Engineer: _____

Reference ☐ Approval ☐ Construction ☐

Schedule #: _____

General Information

- The system shall provide high heating capacity at -4°F (-20°C) with heating operation down to -13°F (-25°C).
- The outdoor unit shall have a base pan heater as standard for optimal defrost cycle water drainage.
- The indoor unit shall have an integral condensate pump with maximum 29" lift from bottom of the unit with check valve and float switch that disables indoor in the event of condensate overflow.
- The system shall feature comfort humidity control. Utilizing an integral humidity sensor, the system optimizes the indoor unit coil temperature according to the dew point, maximizing energy savings while still providing space dehumidification and occupant comfort.
- The system shall have a built-in Wi-Fi adapter as standard to allow control and monitoring using the Samsung SmartThings app.
- Auto-restart after power loss
- Soft-start compressor minimizing current inrush
- The outdoor unit shall provide 208/230V power to the indoor unit via 14 AWG X 3 interconnect power cable.

Construction

- Outdoor unit: Galvanized steel with a baked-on powder coated finish for durability.
- Indoor unit: Insulated, galvanized steel.
- All heat exchangers shall be mechanically bonded aluminum fin to copper tube.
- The outdoor unit shall supply power to indoor unit via 14 AWG X 3 power wire.

Refrigerant System


- The system shall utilize low-GWP R-32 refrigerant
- Refrigerant flow shall be controlled by electronic expansion valve at the outdoor unit.
- The system shall include an R32 alarm output plug on the indoor unit and outdoor unit for notification of R32 leak detection when the optional refrigerant leak detector is installed and configured (leak detector and MIM-B14U accessories are required).

Indoor Fan

- Smart pressure control feature that adjusts fan speed based on ESP delivering consistent heating and cooling power
- The indoor unit shall have a smart-tuning function that can provide optimized comfort by allowing the occupant to offset the fan CFM curve to increase or decrease airflow.
- The indoor unit shall have automatic air volume scanning for simple setup and optimized comfort settings for the occupant

Controls

- Control wiring shall be 2 X 16 AWG wire.
- No additional interface modules/adapters are required when connecting to Samsung central control options.
- The unit shall be operated via a wireless or wired remote control with DDC type signal.
- Dual set temperature support when connected to supported controllers.
- Wired or wireless controllers must be purchased separately.

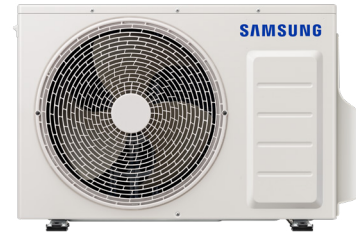

Note: Unit appearance may vary slightly

External Heat Control

- External heat control functionality allows for configuration of fan operation during auxiliary heat operation, defrost, and emergency heat (MIM-B14U accessory required).
- External heat control configuration settings include outside ambient external heat lockout, outside ambient compressor lockout, and time delay options (MIM-B14U accessory required).
- Emergency heat functionality allows the system to continue controlling the external heat source even when system errors prevent the heat pump from operating (MIM-B14U accessory required).
- External heat control functionality allows for configuration of fan operation during auxiliary heat operation, defrost, and emergency heat
- Emergency heat functionality allows the system to continue controlling the external heat source even when system errors prevent the heat pump from operating

Convenience

- The outdoor unit shall have snow accumulation prevention option setting to prevent snow drifting against an idle outdoor unit.
- Night-time Quiet Mode: reduction of operational sound during evening hours (automatic or manual activation).
- Emergency Temperature Output (ETO) function: when indoor unit is in error status or when room temperature exceeds configurable temperature level, the system outputs a signal to an external source, e.g., backup system, building management system, alert device (ex: status light, warning lamp, buzzer).
- The system can be configured as heating/cooling, cooling only, or heating only via outdoor unit option setting.
- Maximum Current Control configurable from 50% - 100% via outdoor unit, wired controller or central control.



Intertek



Proper sizing and installation of equipment is critical to achieve optimal performance. Split system air conditioners and heat pumps (excluding ductless systems) must be matched with appropriate coil components to meet ENERGY STAR criteria. Ask your contractor or visit www.energystar.gov.

Samsung HVAC maintains a policy of ongoing development. Specifications are subject to change without notice. Refer to www.AHRIdirectory.org for current reference numbers.

System Specifications

Model	Indoor Unit Model Number (US Code)		AC009DNHDCG/AA (CNG09HDD)
	Outdoor Unit Model Number (US Code)		AC009DXSCCG/AA (CXG09SCD)
Performance	Nominal Capacity	Cooling / Heating (Btu/h)	9,000 / 12,000
	Capacity Range	Cooling (Btu/h)	3,300 - 14,000
		Heating (Btu/h)	2,800 - 15,000
	AHRI 210-240 2023	SEER2	18.90
		EER2	12.70
		HSPF2 (region IV)	10.00
		5°F COP	1.80
Power	Voltage	ø / V / Hz	1 / 208-230 / 60
	Working Voltage Range (VAC)		187 - 253
	Operating Current (min. / standard / max.)	Cooling (A)	1.4 / 3.1 / 6.4
		Heating (A)	1.1 / 4.3 / 8.9
	Max. Breaker	Amps	15.0
	Min. Circuit Ampacity	Amps	13.9
Dimensions	W X H X D (in.)	Indoor Unit	33 7/16 X 9 13/16 X 27 9/16
		Outdoor Unit	31 1/8 X 21 5/8 X 11 3/16
	Weight (lbs.)	Indoor Unit	59.50
		Outdoor Unit	67.20
	Duct Connections (W X H)	Supply (in.)	32 3/16 X 8 11/16
		Return (ID, in.)	33 3/16 X 8 11/16
Sound Pressure Level	Indoor Unit dB(A)	L / M / H	28 / 35 / 41
	Outdoor Unit dB(A)	Cooling / Heating (high)	53 / 53
Operating Temperatures	Outdoor	Cooling	23 - 122°F (-5 - 50°C)
			0 - 122°F (-18 - 50°C) W/Baffle
	Indoor	Heating	-13 - 75°F (-25 - 24°C)
		Cooling	64 ~ 90°F (16 ~ 32°C)
		Heating	T ≤ 86°F (30°C)
Pipe Connections	Indoor & Outdoor	High side (In.)	1/4
		Low side (In.)	3/8
	Maximum (ft.)		66
	Maximum Vertical Separation (ft.)		49
	Condensate Connection		1 1/4 in. OD, 1 in. ID
Refrigerant	Type		R-32
	A2L Leak Detection		Optional Accessory
	Factory Charge/Max Charge	oz.	31.7 / 38.4
	Charged for		24.6 ft.
	Trim Charge	oz./ft	0.161
Compressor	Type		Inverter Driven, Twin BLDC Rotary
	RLA	Amps	8.4
Evaporator Fan	Type		BLDC (1) With Sirocco Fan (2)
	Output	Watts	153
	External Static Pressure	Standard ("WC)	0.58
		Min. / Max. ("WC)	0.1 / 0.59
Airflow	Air Volume (L/M/H)	Cooling (CFM)	279 / 364 / 456
		Heating (CFM)	279 / 364 / 456
Condenser Fan	Type		BLDC With Axial Type Fan (1)
	MOC / Watts / CFM (max.)		0.42A X 1 / 40W X 1 / 1,060
Corrosion Prevention	ISO-9227 - The condenser heat exchanger showed no unusual rust or corrosion development to 2,280 hours.		
Safety	Certifications	UL 60335-2-40	


Accessories

R32 Refrigerant leak detector (RDS)		☐	MRS-H32U
Wired controller	Advanced	☐	MWR-WG01UN
	Touchscreen	☐	MWR-SH12UN
Thermostat adapter (for connection to standard 24VAC thermostats)		☐	MIM-A60UN
Wireless control	Wireless signal receiver	☐	MRK-A10UN
	Wireless controller	☐	AR-CH01U
External temperature sensor		☐	MRW-TAU
External contact control interface module		☐	MIM-B14U
Filter box		☐	FB-DS1
Wall bracket (for outdoor unit)		☐	CKN-250
Wind baffles	Front	☐	WBF-3M-B
	Back	☐	WBB-5M
Hail guard kit (includes back and side guards)		☐	HGK-1
Line set - insulated and flared, interconnect cables included	25'	☐	ILS2506
	50'	☐	ILS5006

Dimensional Drawing

AC009DNHDCG/AA (CNG09HDD)


Unit: Inches

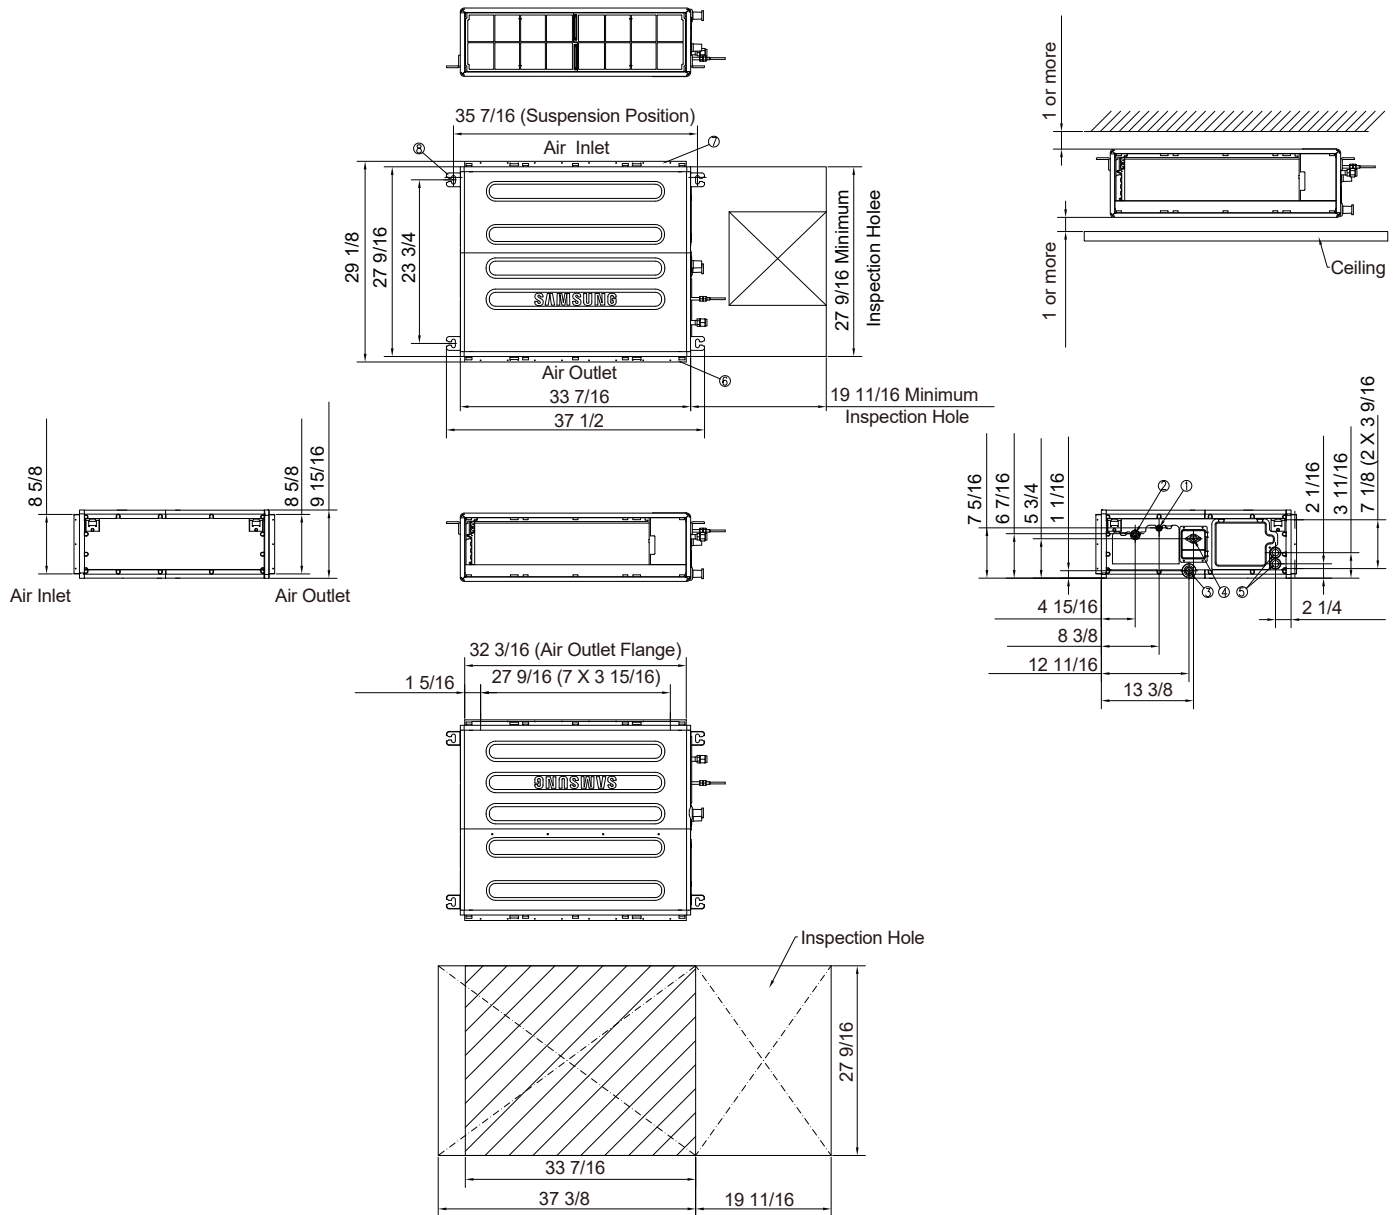

No.	Description
1	Liquid pipe connection
2	Gas pipe connection
3	Gravity drain connection
4	Drain connection
5	Opening for power and communication wire conduit
6	Supply air outlet flange
7	Return air (air inlet)
8	Suspension bolt anchor point

Dimensional Drawing
AC009DXSCCG/AA (CXG09SCD)

Unit: Inches

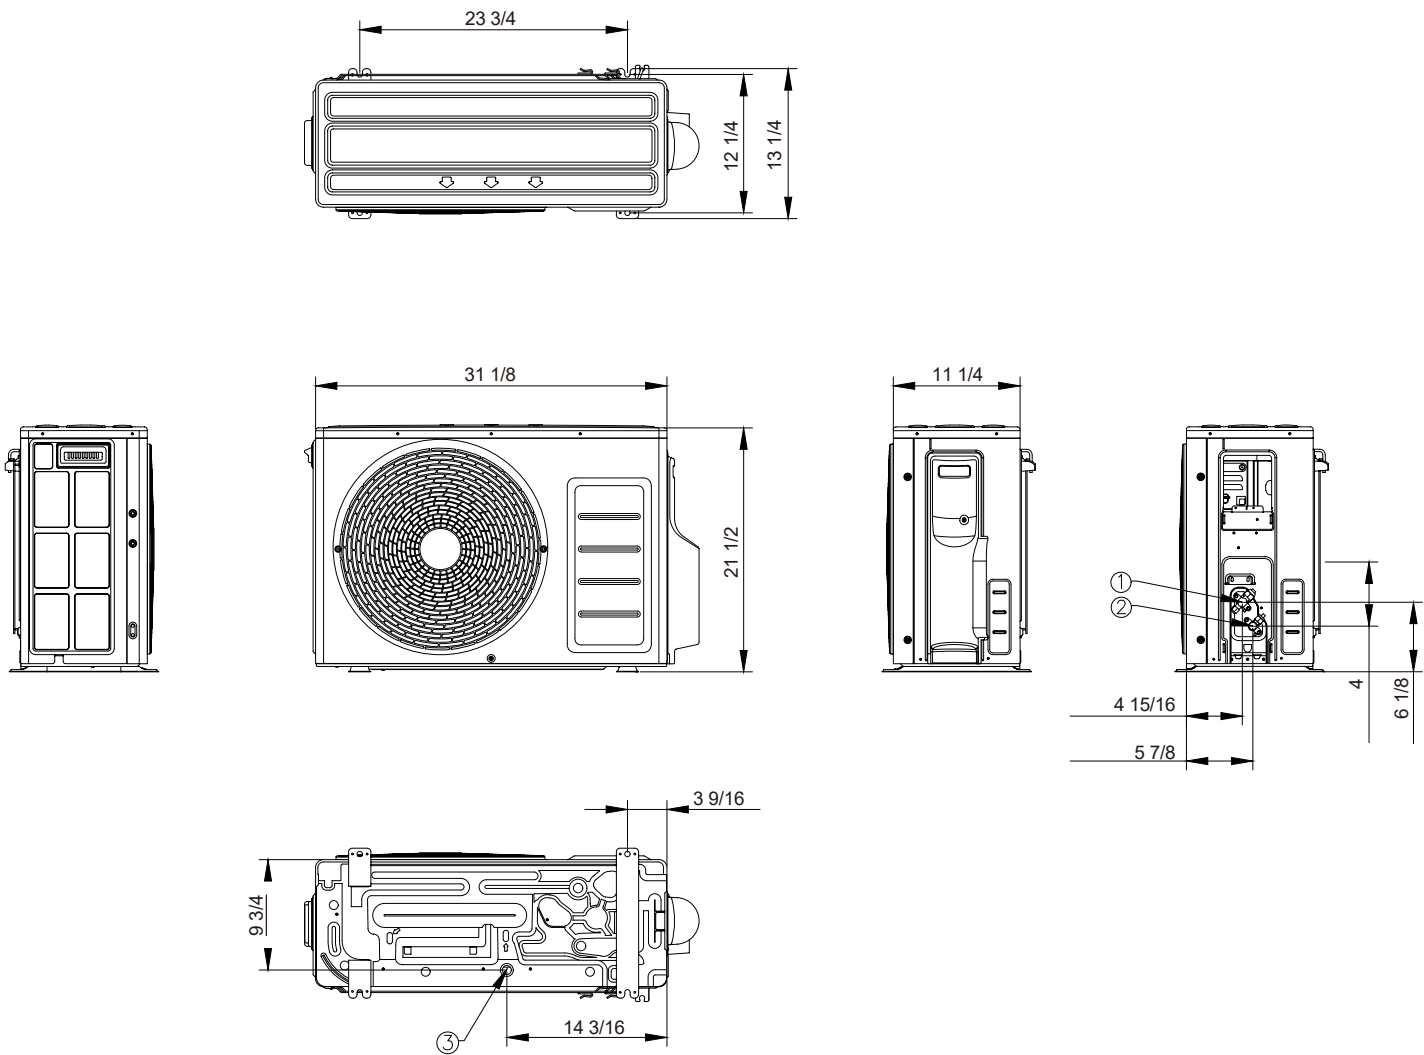

No.	Description
1	Gas pipe connection
2	Liquid pipe connection
3	Drain pipe connection