

Job Name _____
Purchaser _____
Submitted to _____
Unit Designation _____

Location _____
Engineer _____
Reference ☐ Approval ☐ Construction ☐
Schedule # _____

Specifications

Model	Indoor Unit Model Number (US Code)		AC036KNZDCH/AA (CNH36ZDK)
	Outdoor Unit Model Number (US Code)		AC036JXSCCH/AA (CXH36SCJ)
Performance	Nominal Capacity ¹	Cooling / Heating (Btu/h)	36,000 / 40,000
	Capacity Range	Cooling (Btu/h)	14,000 - 42,000
		Heating (Btu/h)	12,000 - 48,000
	Heating Capacity at -13°F Outdoor DB, 70°F Indoor DB (Btu/h)		31,200
	SEER / EER		20.0 / 11.0
	COP (nominal heating)		3.32
	HSPF		10.4
	AHRI Certification Number		9955838
Power (without optional heat kits)	Voltage	ø / V / Hz	1 / 208-230 / 60
	Working Voltage Range (VAC)		176 - 254 (max. 3% deviation from each)
	Operating Current (min. / std. / max.)	Cooling (A)	4.8 / 14.8 / 17.0
		Heating (A)	3.7 / 15.9 / 23.0
	Max. Breaker	Amps	45
Dimensions	W X H X D (in.)	Indoor Unit	21 X 48 X 21
		Outdoor Unit	37 X 55 7/8 X 13
	Weight (lbs.)	Indoor Unit	123.5
		Outdoor Unit	211.64
Sound Pressure Level	Indoor Unit dB(A)	L / M / H	36 / 39 / 42
	Outdoor Unit dB(A)	Cooling / Heating (high)	51 / 53
Operating Temperatures °F(°C)	Outdoor	Cooling	23 ~ 115°F(-5 ~ 46°C)
		Heating	-4 ~ 115°F(-20 ~ 46°C) w/ baffle
	Indoor	Cooling	-13 ~ 75°F(-25 ~ 24°C)
		Heating	61 ~ 90°F(16 ~ 32°C) T ≤ 80°F(27°C)
Pipe Connections	Indoor & Outdoor	High side (flare)	3/8"
		Low side (flare)	5/8"
	Maximum (ft.)		246
	Maximum Vertical Separation (ft.)		98
Refrigerant	Factory Charge		oz.
	Charged for		102.24
	Additional Refrigerant		25 ft
Compressor	Type		Inverter Driven, Twin BLDC Rotary
	RLA		20.0
Evaporator Fan	Type		Double-inlet, forward curve, centrifugal (with ECM motor)
	Air Volume	CFM (L/M/H)	883 / 1,042 / 1,165 (at standard ESP)
		Total CFM Range ²	419 - 1,314
	HP		1/2
	Motor Amps	A	1.66
	External Static	Standard	0.24
Condenser Fan	Pressure ("WC)		0 / 1.0
	Motor		BLDC With Axial Type Fan (2)
Safety	FLA / Watts / CFM (max.)		0.48 A X 2 / 125 W X 2 / 4,415 CFM
	Certifications		ETL (UL 1995)
Safety	Devices: PCB fuses, indoor unit terminal block thermal fuse, current transformer, over-voltage protection, crankcase heating, temperature limit protection logic, compressor overload sensing		



- General Information**
- High heating performance at -13°F
 - Auto-restart after power loss
 - The indoor unit shall be capable of being field convertible to downflow configuration with optional downflow conversion kit.
 - The outdoor unit shall have a snow accumulation prevention option setting to prevent snow drifting against an idle outdoor unit.
 - The indoor and outdoor units shall have a removable EEPROM that stores system programming information, unit name, and other data
 - The outdoor unit shall have a night time quiet mode option to reduce operating sound during the night (automatic or manual activation with dry contact signal).
 - The pipe connections at the outdoor unit shall be internal allowing pipes to inter the chassis through the front, right side, bottom, or back.
 - Air handler has an air leakage of no more than 2 percent of the design air flow rate when tested in accordance with ASHRAE 193.
 - The outdoor unit shall supply power to indoor unit via 14 AWG X 3 power wire when optional heat kits are not installed. If VHK-***A supplemental heat kits are installed, power to the heat kits must be provided from a dedicated circuit with proper overcurrent protection per NEC (refer to VHK-***A supporting documents for heat kit electrical data).
 - The outdoor unit shall have a base pan heater as standard (150W)

- Construction**
- The outdoor unit shall be galvanized steel with a baked on powder coated finish for durability
- The indoor unit shall be constructed of insulated, powder coated, galvanized steel
- Indoor Fan**
- The indoor fan is a double-inlet, forward curve, centrifugal type with a single constant-torque (ECM) fan motor
- The indoor unit shall have low, medium, high, and auto fan speed setting options.
- The evaporator fan motor shall have five speed taps
- Heat Exchanger**
- The indoor unit heat exchanger shall be mechanically bonded aluminum fin to copper tube
- The outdoor unit heat exchanger shall be aluminum, flat fin, micro channel

- Controls**
- Control signal shall be a DDC type signal
- Interconnect control wire between outdoor and indoor unit shall be 16AWG X 2 shielded
- Controllers must be purchased separately
- Controls shall integrate with a BMS system

No additional interface modules/adapters are required when connecting to Samsung NASA DVM S central controllers.



- Refrigerant System**
- The refrigerant type shall be R410A
- The compressor shall be hermetically sealed, inverter controlled, twin BLDC Rotary made by Samsung
- Refrigerant flow shall be controlled by an electronic expansion valve at outdoor unit
- Soft-start to reduce current demand during compressor start





Warranty
10 Years compressor, 10 years parts, 1 year limited labor when registered (conditions apply)

Optional Accessories

Wired Controller	Advanced Wired Controller	☐	MWR-WG00UN
	Simplified Touch Controller	☐	MWR-SH11UN
Wi-Fi Adapter		☐	MIM-H04UN
Wireless Signal Control	Wireless Signal Receiver	☐	MRK-A10N
	Wireless Controller	☐	AR-EH03U
External Temperature Sensor		☐	MRW-TA
External Contact Control		☐	MIM-B14
Filter Box (includes 1" MERV 8 filter)		☐	VFB-2
Supplemental Electric Heat Kits	5kW	☐	VHK-205A
	10kW	☐	VHK-210A
Wall Bracket (for outdoor unit)		☐	CKN-250
Wind Baffles	Front	☐	WBF-6M
	Back	☐	WBB-4M
Line Sets - insulated and flared, interconnect cables included		☐	25' - ILS2510
		☐	50' - ILS5010
Downflow Conversion Kit		☐	VDK-2
Thermostat Adaptor (for connection to a standard 24VAC thermostat)		☐	MIM-A60UN

No.	Description
①	Gas Pipe
②	Liquid Pipe
③	Drain Connection
④	Air Outlet
⑤	Air Inlet

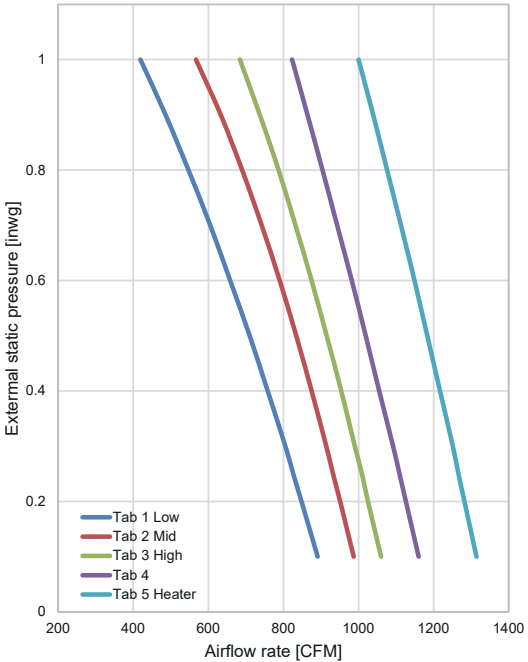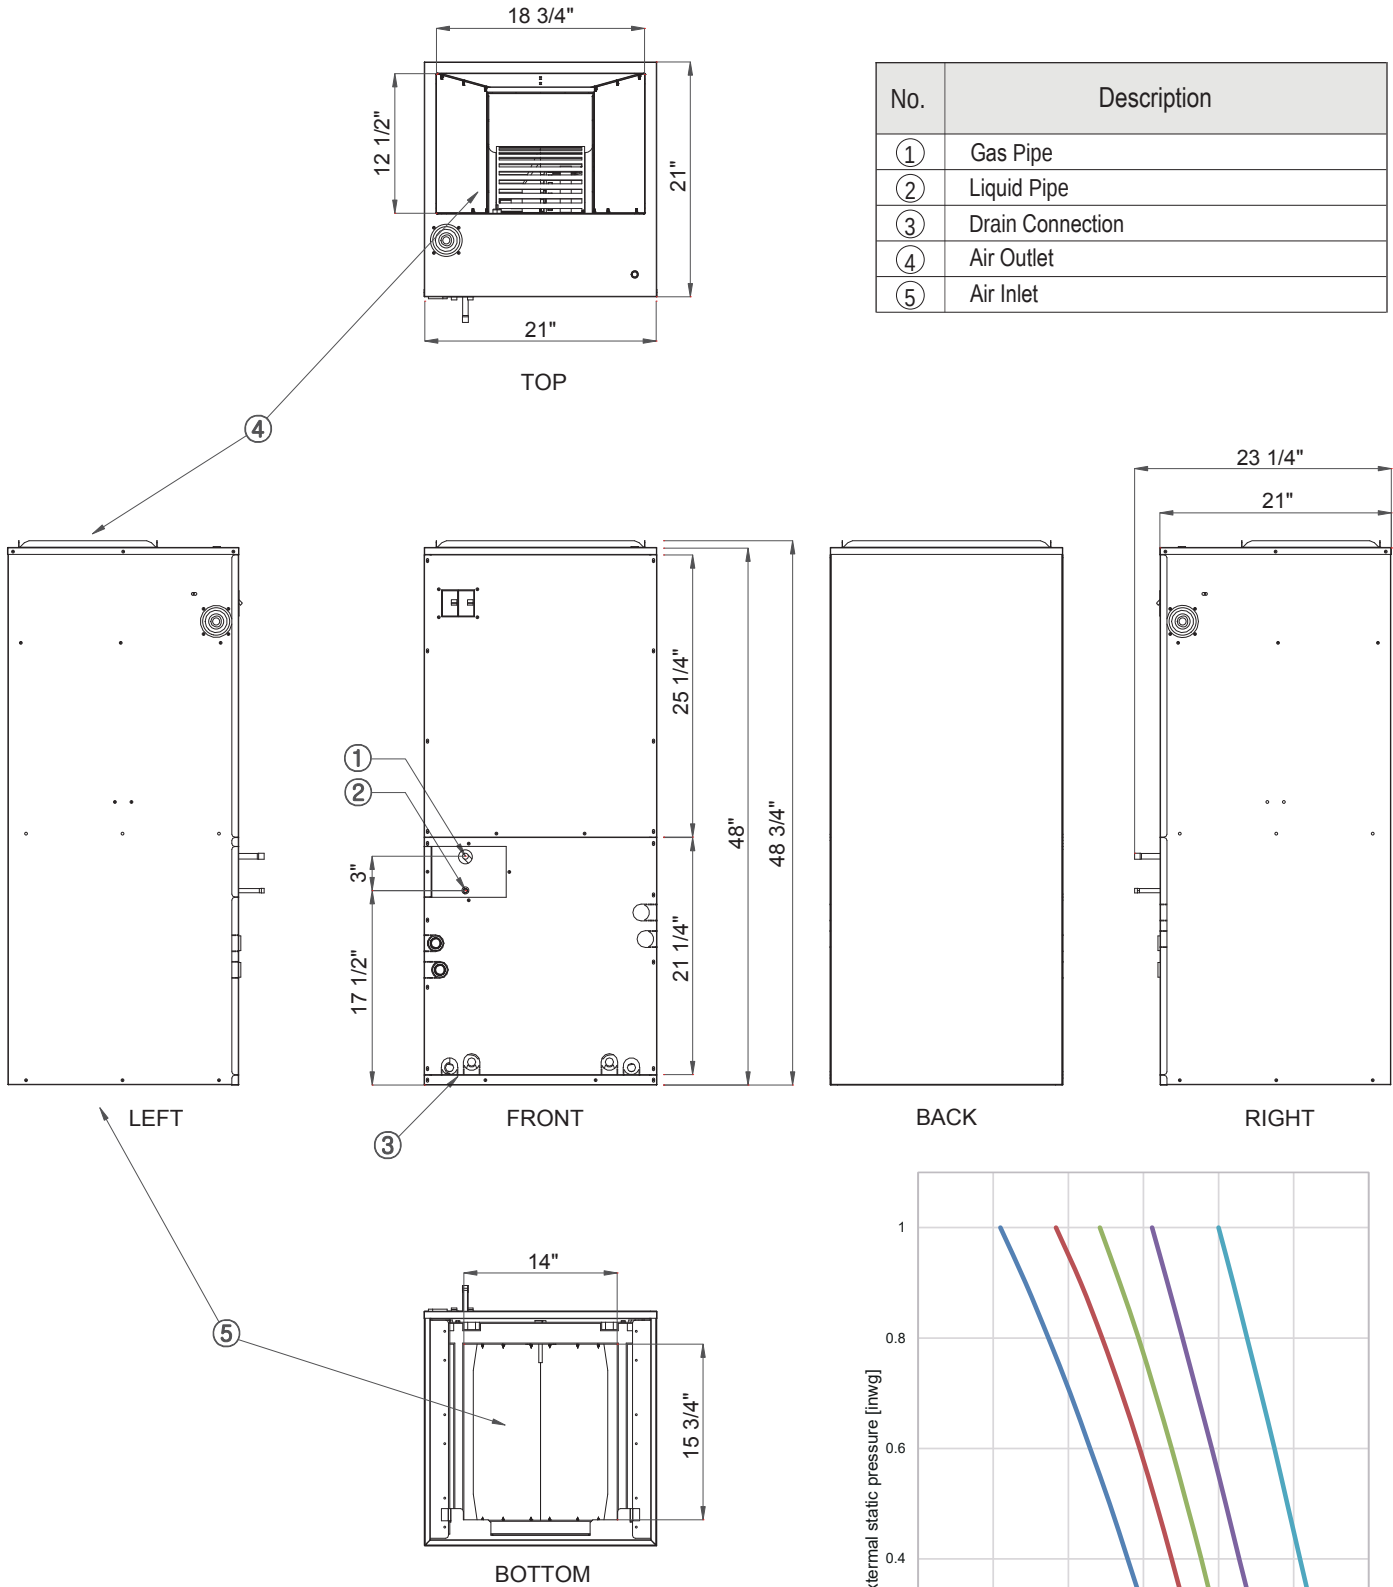

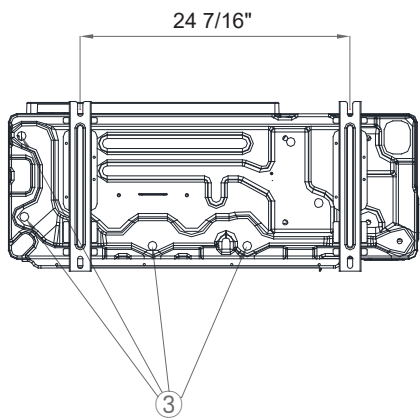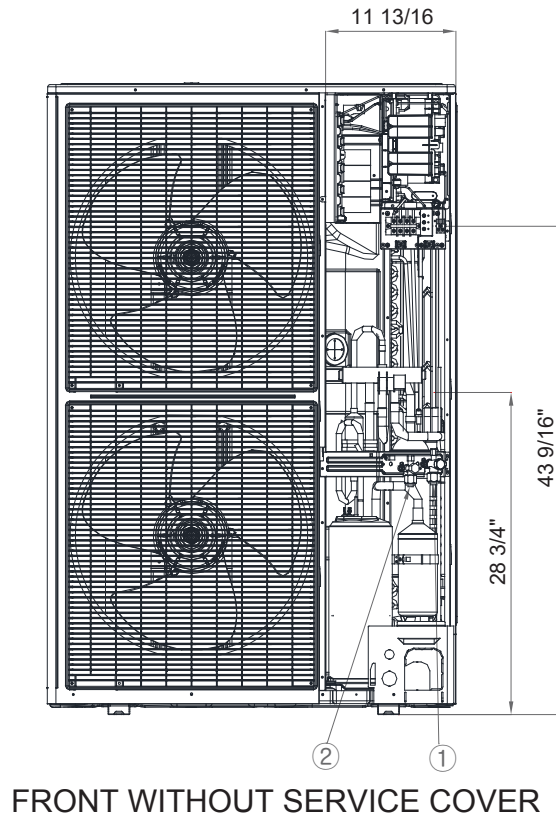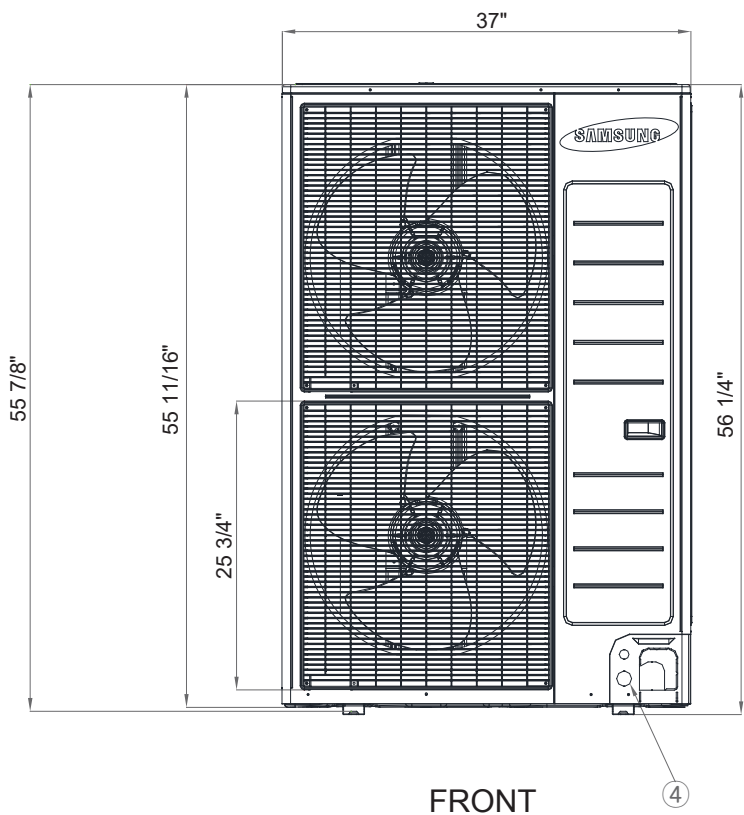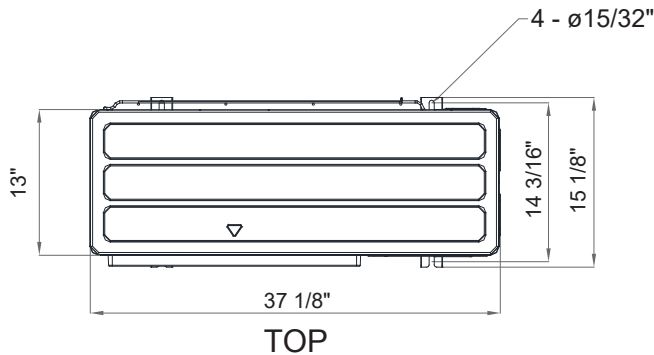

No.	Description
1	Suction service valve
2	Liquid service valve
3	Drain opening
4	Power and communication conduit openings