

SAMSUNG

SUBMITTAL DATA

AM060FCMDCG/AA DVM S Mini Series, Heat Pump Condensing Unit

Job Name: _____

Location: _____

Purchaser: _____

Engineer: _____

Submitted to: _____

Reference ☐ Approval ☐ Construction ☐

Unit Designation: _____

Schedule #: _____

General Information

- Compatible with Samsung R-32 DVM S indoor units (AM*****DCG/AA) and upcoming R-32 Universal Communication Kit.
- Active AI control enhances operational performance: AI Low Pressure Control can improve cooling speed up to 21%; AI High Pressure Control reduces unnecessarily high pressures, improving efficiency and reducing power consumption.
- Auto-restart after power loss
- Soft-start compressor minimizing current inrush

Construction


- Galvanized steel with a baked-on powder coated finish for durability.
- The heat exchanger shall be mechanically bonded aluminum fin to copper tube.

Refrigerant System

- The system shall utilize low-GWP R-32 refrigerant
- The compressors shall be hermetically sealed, inverter driven, flash injected scroll type.
- The outdoor unit shall pump down the refrigerant in the event an indoor unit detects a refrigerant leak. The sequence of operations shall include closing refrigerant isolation valves at the end of the pump down process to secure as much refrigerant as possible in the outdoor unit in the event of refrigerant leakage within an indoor door unit.
- Refrigerant flow shall be controlled by an EEV (electronic expansion valve) throughout the system.
- A flat plate subcooler device will improve capacity at extreme system refrigerant pipe lengths and reduce refrigerant noise.
- The system shall include an R32 alarm output plug on the indoor unit and outdoor unit for notification of R32 leak when an indoor unit refrigerant leak detector detects a leak (MIM-B14U accessories are required).

Controls

- Control wiring shall be 2 X 16 AWG wire.
- No additional interface modules/adapters are required when connecting to Samsung central control options.

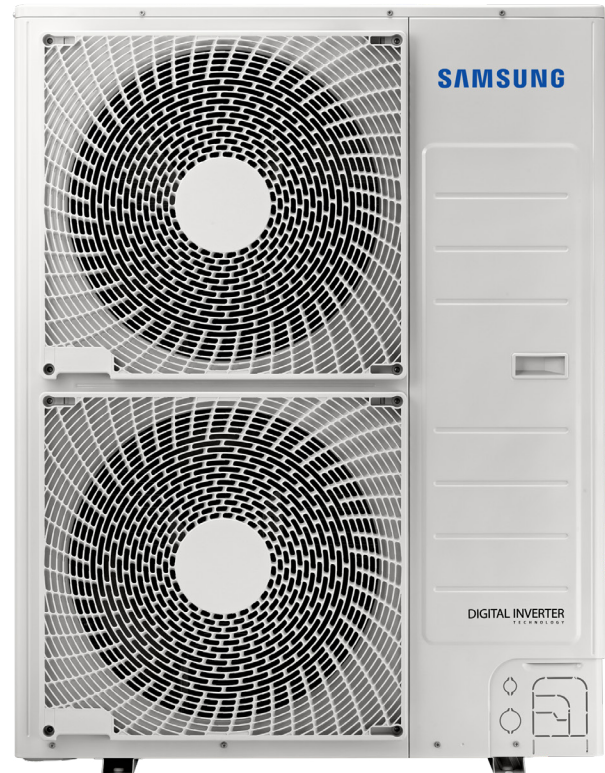

Convenience

- The outdoor unit shall have snow accumulation prevention option setting to prevent snow drifting against an idle outdoor unit.
- Night-time Quiet Mode: reduction of operational sound during evening hours (automatic or manual activation).
- Maximum Current Control configurable from 50% - 100% via outdoor unit, wired controller or central control.



Proper sizing and installation of equipment is critical to achieve optimal performance. Split system air conditioners and heat pumps (excluding ductless systems) must be matched with appropriate coil components to meet ENERGY STAR criteria. Ask your contractor or visit www.energystar.gov.

Specifications AM060FCMDCG/AA

Model	Outdoor Unit Model Number (US Code)		AM060FCMDCG/AA
Performance	Rated Capacity*	Cooling (Btu/h)	60,000
		Heating (Btu/h)	66,000
	Heating Capacity at 5°F OA, 70°F Indoor DB (Btu/h, Ducted)		47,000
	SEER2 (Ducted / Mixed / Non-ducted)		16.5 / 18.25 / 20
	EER2 (Ducted / Mixed / Non-ducted)		10 / 11 / 12
	HSPF2 (Ducted / Mixed / Non-ducted)		9.5 / 9.85 / 10.2
Power	Voltage	ø / V / Hz	1 / 208-230 / 60
	Working Voltage Range (VAC)		187 - 253
	Nominal Current**	Cooling (A)	26.5
		Heating (A)	25.6
	Max. Breaker	Amps	40
	Min. Circuit Ampacity	Amps	32
Dimensions	W X H X D	In.	37 x 55-15/16 x 13
	Weight	lbs.	243.60
Sound Pressure Level	Cooling / Heating (high)		55 / 57
Operating Temperatures	Outdoor	Cooling	23 - 118°F (-5 - 48°C)
			0 - 118°F (-18 - 48°C) W/Baffle
		Heating	-22 - 75°F (-30 - 24°C)
Pipe Connections	High side		3/8
	Low side (suction)		3/4
	Max. Distance - ODU to IDU	ft.	492 (574 equivalent)
	Max. Line Set Length (total)	ft.	984
	Max. Vertical Separation	Outdoor to indoor (ft.)	IDU above ODU: 131, ODU above IDU: 164
		Highest to lowest indoor (ft.)	49
Refrigerant	Type		R-32
	Control Method		Electronic Expansion Valve (D)
	Factory Charge	oz.	105.8
Compressor	Type		Flash Injected, Inverter Driven Scroll
	RLA	Amps	19.3
Condenser Fan	Type		BLDC With Axial Type Fan (2)
	MOC / Watts / CFM (max.)		1.2 / 125W X 2 / 4,415
Corrosion Prevention	ISO-9227 - The condenser heat exchanger showed no unusual rust or corrosion development to 3,000 hours.		
Safety	Certifications		UL 60335-2-40
	Devices	PCB fuses, indoor unit terminal block thermal fuse, current transformer, over-voltage protection, crankcase heating, temperature limit protection logic, compressor overload sensing	

*Standard capacity is based on non-ducted rated capacity. Minimum and maximum capacity will vary based on connected indoor unit type, capacity, and quantity along with indoor and outdoor temperatures. Refer to system capacity tables for full capacity details.

**Rated current based on highest combination ratio of non-ducted indoor units.


Accessories AM060FCMDCG/AA

Wind baffles	Front	☐ WBF-8M
	Back	☐ WBB-8M
Hail guard kit (includes back and side guards)		☐ HGK-8
Mode selector switch for HP systems		☐ MCM-C200U
Base pan heater kit		☐ MHC-015EEU
External contact control interface module (operation and error output, night silent mode manual activation)		☐ MIM-B14U
Wall bracket		☐ CKN-250

Dimensional Drawing

AM060FCMDCG/AA

Unit: Inches

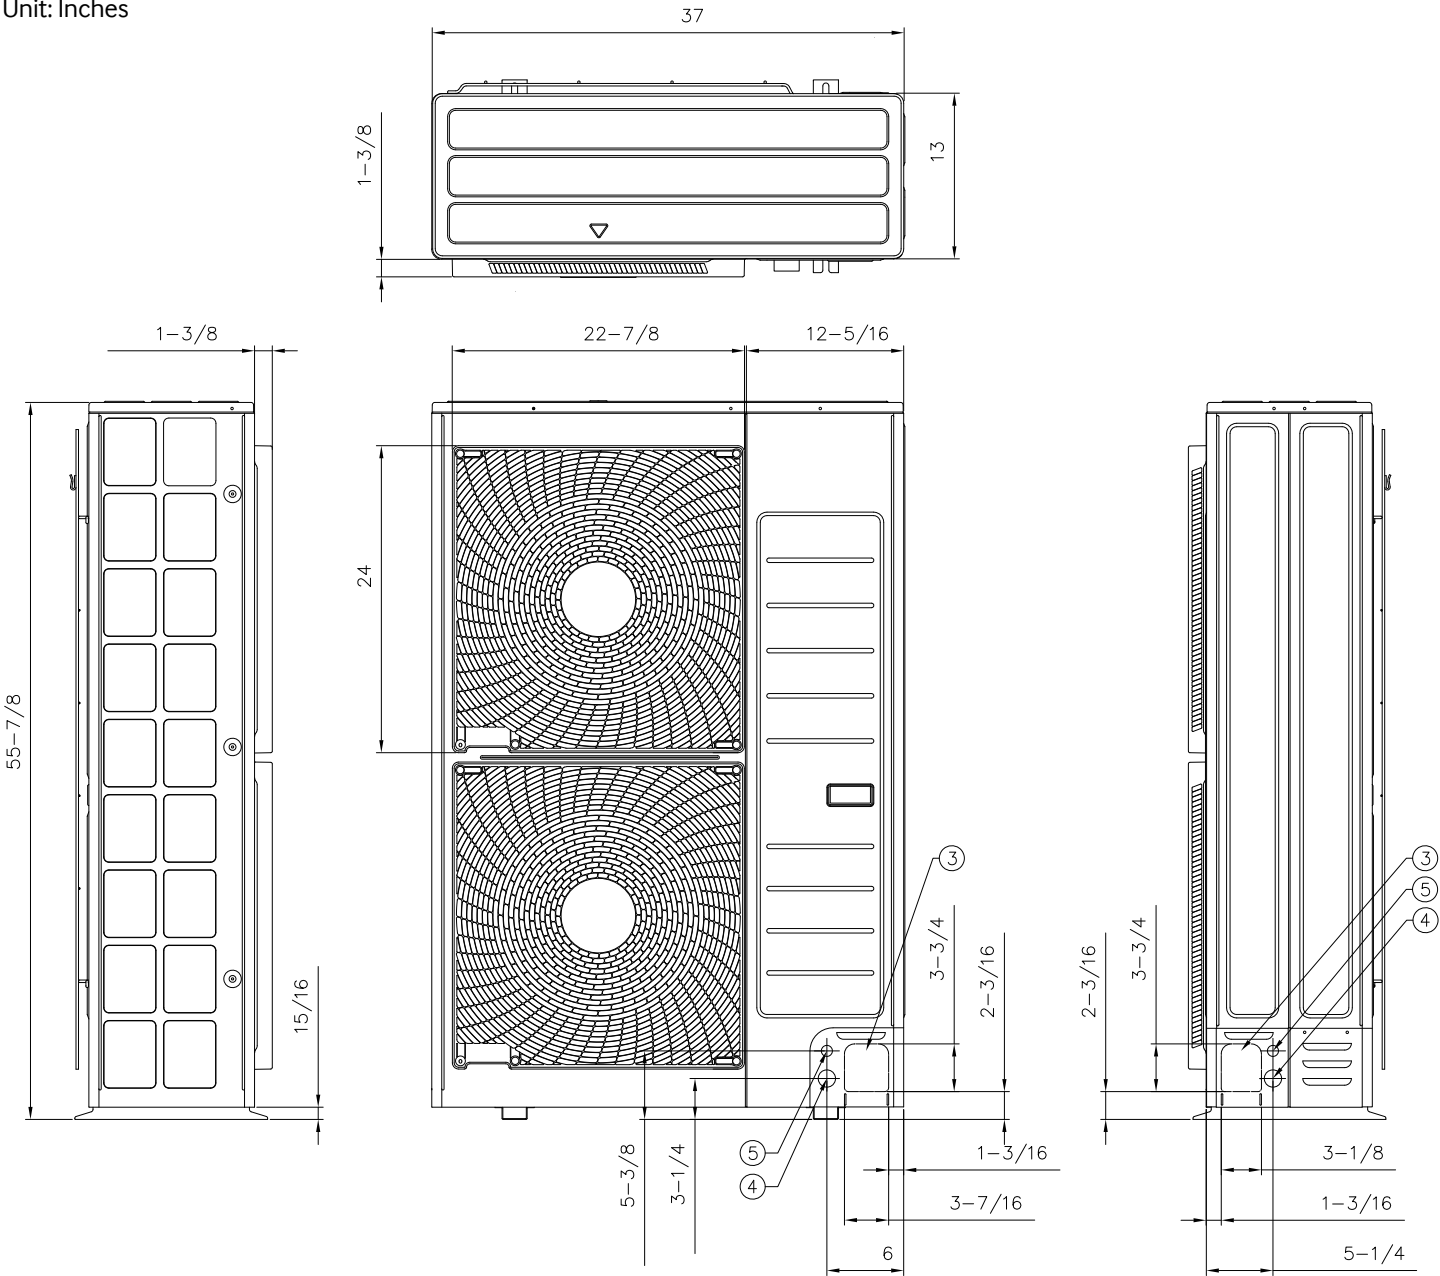

No.	Description
3	Pipe Intake Knockout Hole
4	Opening for Power Wire Conduit (1 3/8)
5	Opening for Communication Conduit (7/8)

Dimensional Drawing

AM060FCMDCG/AA

Unit: Inches

