

SAMSUNG

Submittal Data

MRS-L32U

R32 Leak Detector Accessory for Slim Duct Models

Job name: _____

Location: _____

Purchaser: _____

Engineer: _____

Submitted to: _____




Reference ☐ Approval ☐ Construction ☐

Unit designation: _____

Schedule #: _____

General Information

- Accessory R32 leak detector for CAC R32 Slim Duct units (AC0**DNLDCG/AA)
- When a leak is detected, the indoor unit will activate leak mitigation sequence of operations.
- Installs on the side of the ducted unit and plugs into the indoor unit control PCB (the indoor unit must be configured to for the leak detector to be enabled).

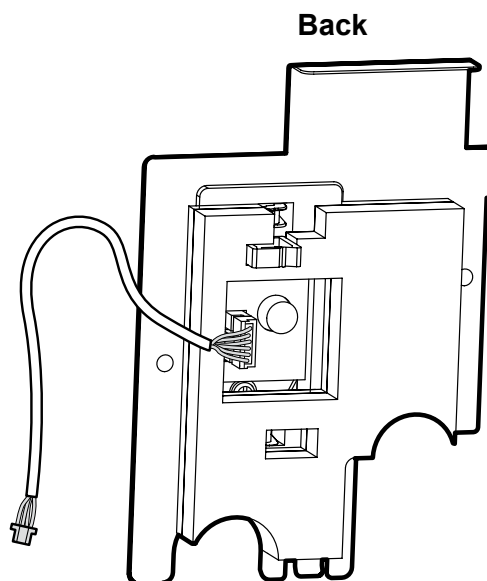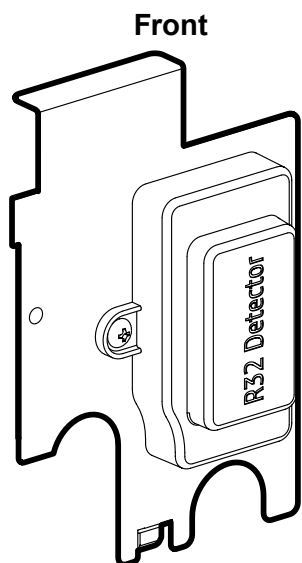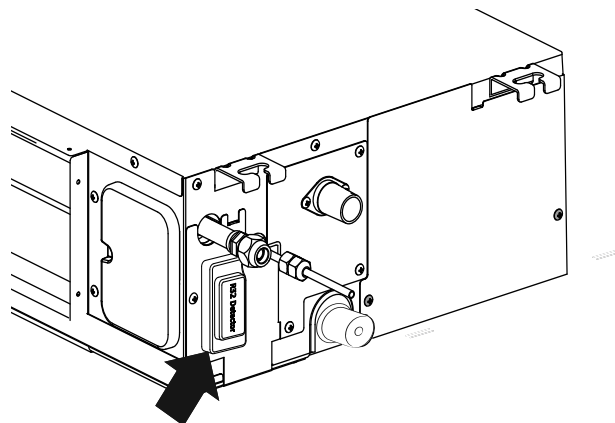

Samsung HVAC maintains a policy of ongoing development. Specifications are subject to change without notice.