

|                  |                                    |                                   |                                       |
|------------------|------------------------------------|-----------------------------------|---------------------------------------|
| Job Name         | Location                           |                                   |                                       |
| Purchaser        | Engineer                           |                                   |                                       |
| Submitted to     | Reference <input type="checkbox"/> | Approval <input type="checkbox"/> | Construction <input type="checkbox"/> |
| Unit Designation | Schedule #                         |                                   |                                       |

## Downflow kit(s) on this project

|                          | Model number | Description                  |
|--------------------------|--------------|------------------------------|
| <input type="checkbox"/> | VDK-1        | Downflow kit, small chassis  |
| <input type="checkbox"/> | VDK-2        | Downflow kit, medium chassis |
| <input type="checkbox"/> | VDK-3        | Downflow kit, large chassis  |

A downflow kit is required when airflow from the unit must blow downward.

Included in the kit: AHU coil door and return air temperature sensor holder. The original coil door can be discarded.



## Compatibility

| Model Number | DVM S                       | CAC 1:1        |
|--------------|-----------------------------|----------------|
| VDK-1        | AM012*NZDCH/AA <sup>1</sup> | -              |
|              | AM018*NZDCH/AA <sup>1</sup> | AC018*NZDCH/AA |
|              | AM024*NZDCH/AA <sup>1</sup> | AC024*NZDCH/AA |
| VDK-2        | AM030*NZDCH/AA <sup>1</sup> | AC030*NZDCH/AA |
|              | AM036*NZDCH/AA <sup>1</sup> | AC036*NZDCH/AA |
| VDK-3        | -                           | AC042*NZDCH/AA |
|              | AM048*NZDCH/AA              | AC048*NZDCH/AA |
|              | AM054*NZDCH/AA              | AC054KNZDCH/AA |
|              | AM060*NZDCH/AA              | -              |
|              | AM072*NZDCH/AA              | -              |

EEV extension wire harness shall be needed for noted models, and purchased separately.

Electric heat kits cannot be installed when using a downflow kit.

<sup>1</sup> Will require EEV extension wire harness, part number DB82-05832A, sold separately.

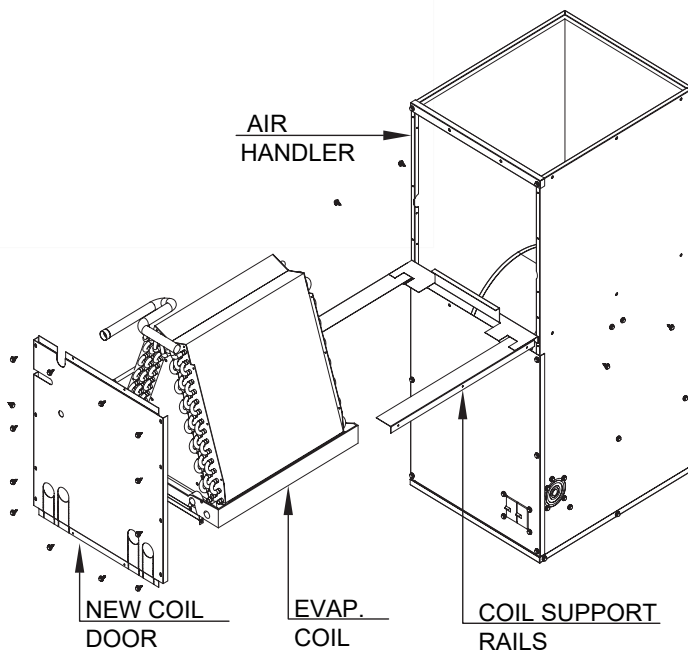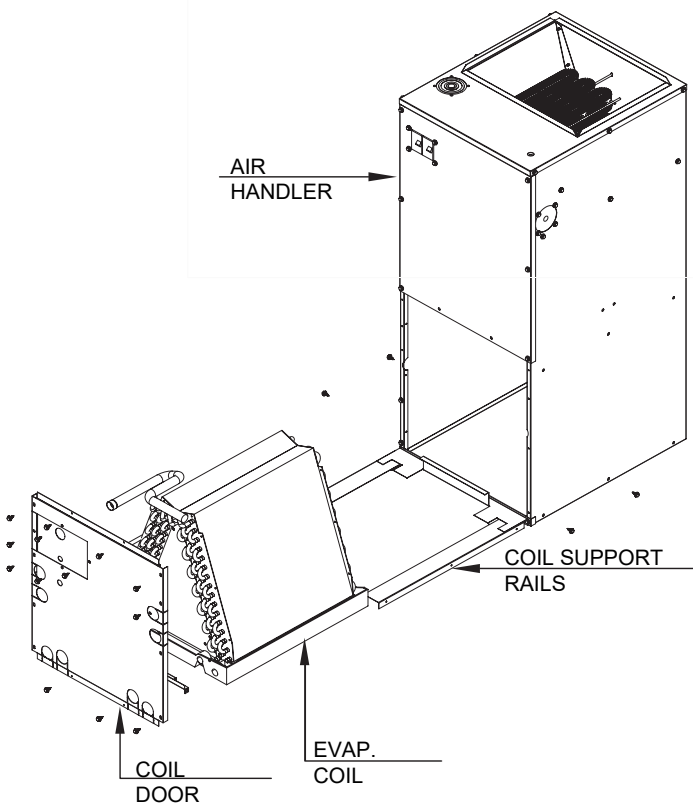

888-699-6067

www.SamsungHVAC.com