


Job or Customer :	
Location :	
Engineer :	
☐ Complies with Spec ☐ Alternate	Notes :
Contractor :	
HeatLink Rep :	
Submitted By :	Date :
Approved By :	Date :
P.O. Number :	Date :

Description

Solid no lead (Eco) Brass PEX F1960 tees for PEX-a potable water expansion systems.

PEX F1960 Tees

Qty	Stk. #	Size (run × run × branch)	Dimension, in/(mm)										Weight, lb/(kg)
			A	B	C	D	E	F	G	ID1	ID2	ID3	
	EX26555NL	½" × ½" × ½"	0.70 (17.8)	0.32 (8.1)	0.32 (8.1)	0.70 (17.8)	0.30 (7.6)	0.50 (12.7)	0.70 (18.1)	0.40 (10.2)	0.40 (10.2)	0.40 (10.2)	0.132 (0.060)
	EX26222NL	¾" × ¾" × ¾"	0.95 (24.1)	0.45 (11.4)	0.45 (11.4)	0.95 (24.1)	0.47 (11.9)	0.64 (16.3)	0.95 (24.1)	0.60 (15.2)	0.60 (15.2)	0.60 (15.2)	0.293 (0.133)
	EX26888NL	1" × 1" × 1"	1.20 (30.5)	0.56 (14.2)	0.56 (14.2)	1.20 (30.5)	0.60 (15.2)	0.80 (20.3)	1.20 (30.5)	0.80 (20.3)	0.80 (20.3)	0.80 (20.3)	0.499 (0.226)

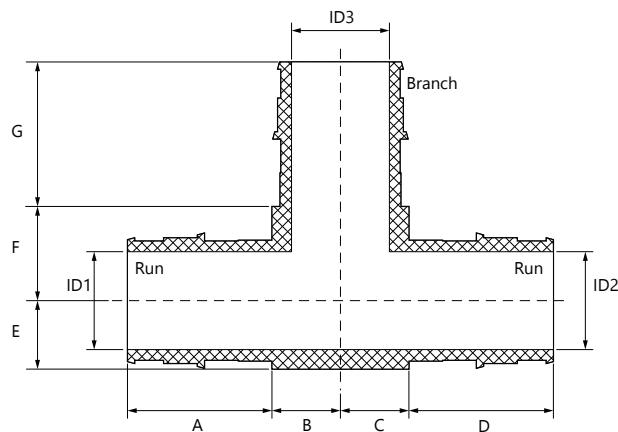

Technical Data

Material	No Lead (Eco) Brass - C69300
Operating pressure rating	180°F @ 100 psi (82.2°C @ 0.69 MPa)

Specifications

Listings

cNSFus-pw-G

Codes


IAPMO UPC

Standards

ASTM F877
ASTM F1960
CSA B137.5
NSF/ANSI 14
NSF/ANSI 61
NSF/ANSI 372

PEX F1960 Reducing Tees

Qty	Stk. #	Size (run × run × branch)	Dimension, in/(mm)										Weight, lb/(kg)
			A	B	C	D	E	F	G	ID1	ID2	ID3	
	EX26255NL	¾" × ½" × ½"	0.90 (22.9)	0.45 (11.4)	0.45 (11.4)	0.70 (17.8)	0.50 (12.7)	0.60 (15.2)	0.70 (17.8)	0.60 (15.2)	0.40 (10.2)	0.40 (10.2)	0.265 (0.120)
	EX26252NL	¾" × ½" × ¾"	0.90 (22.9)	0.45 (11.4)	0.45 (11.4)	0.70 (17.8)	0.50 (12.7)	0.60 (15.2)	0.90 (22.9)	0.60 (15.2)	0.40 (10.2)	0.60 (15.2)	0.264 (0.120)
	EX26225NL	¾" × ¾" × ½"	0.90 (22.9)	0.45 (11.4)	0.45 (11.4)	0.90 (22.9)	0.50 (12.7)	0.70 (17.8)	0.70 (17.8)	0.60 (15.2)	0.60 (15.2)	0.40 (10.2)	0.283 (0.128)
	EX26822NL	1" × ¾" × ¾"	1.20 (30.5)	0.56 (14.2)	0.56 (14.2)	0.90 (22.9)	0.60 (15.2)	0.80 (20.3)	0.90 (22.9)	0.80 (20.3)	0.60 (15.2)	0.60 (15.2)	0.455 (0.206)
	EX26885NL	1" × 1" × ½"	1.20 (30.5)	0.56 (14.2)	0.56 (14.2)	1.20 (30.5)	0.60 (15.2)	0.80 (20.3)	0.70 (17.8)	0.80 (20.3)	0.80 (20.3)	0.40 (10.2)	0.485 (0.220)
	EX26882NL	1" × 1" × ¾"	1.20 (30.5)	0.56 (14.2)	0.56 (14.2)	1.20 (30.5)	0.60 (15.2)	0.80 (20.3)	0.90 (22.9)	0.80 (20.3)	0.80 (20.3)	0.60 (15.2)	0.492 (0.223)

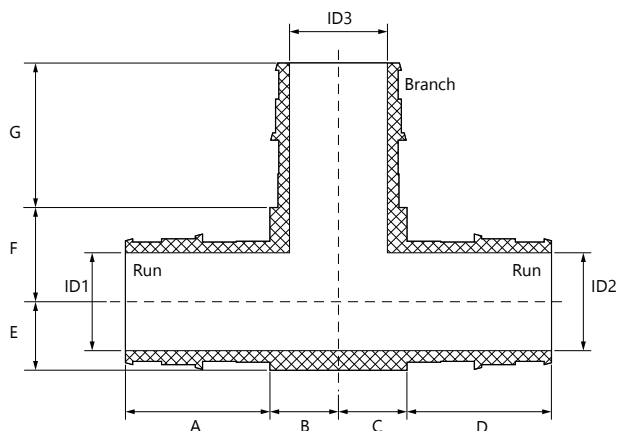

Installation

Installation must follow all of HeatLink's instructions and guidelines.

Related Documents

- F1960 PEX-a Potable Water Expansion System Installation Guide (L3240)
- HeatLink Limited Plumbing Warranty